


FNAME

REVDATE

USER

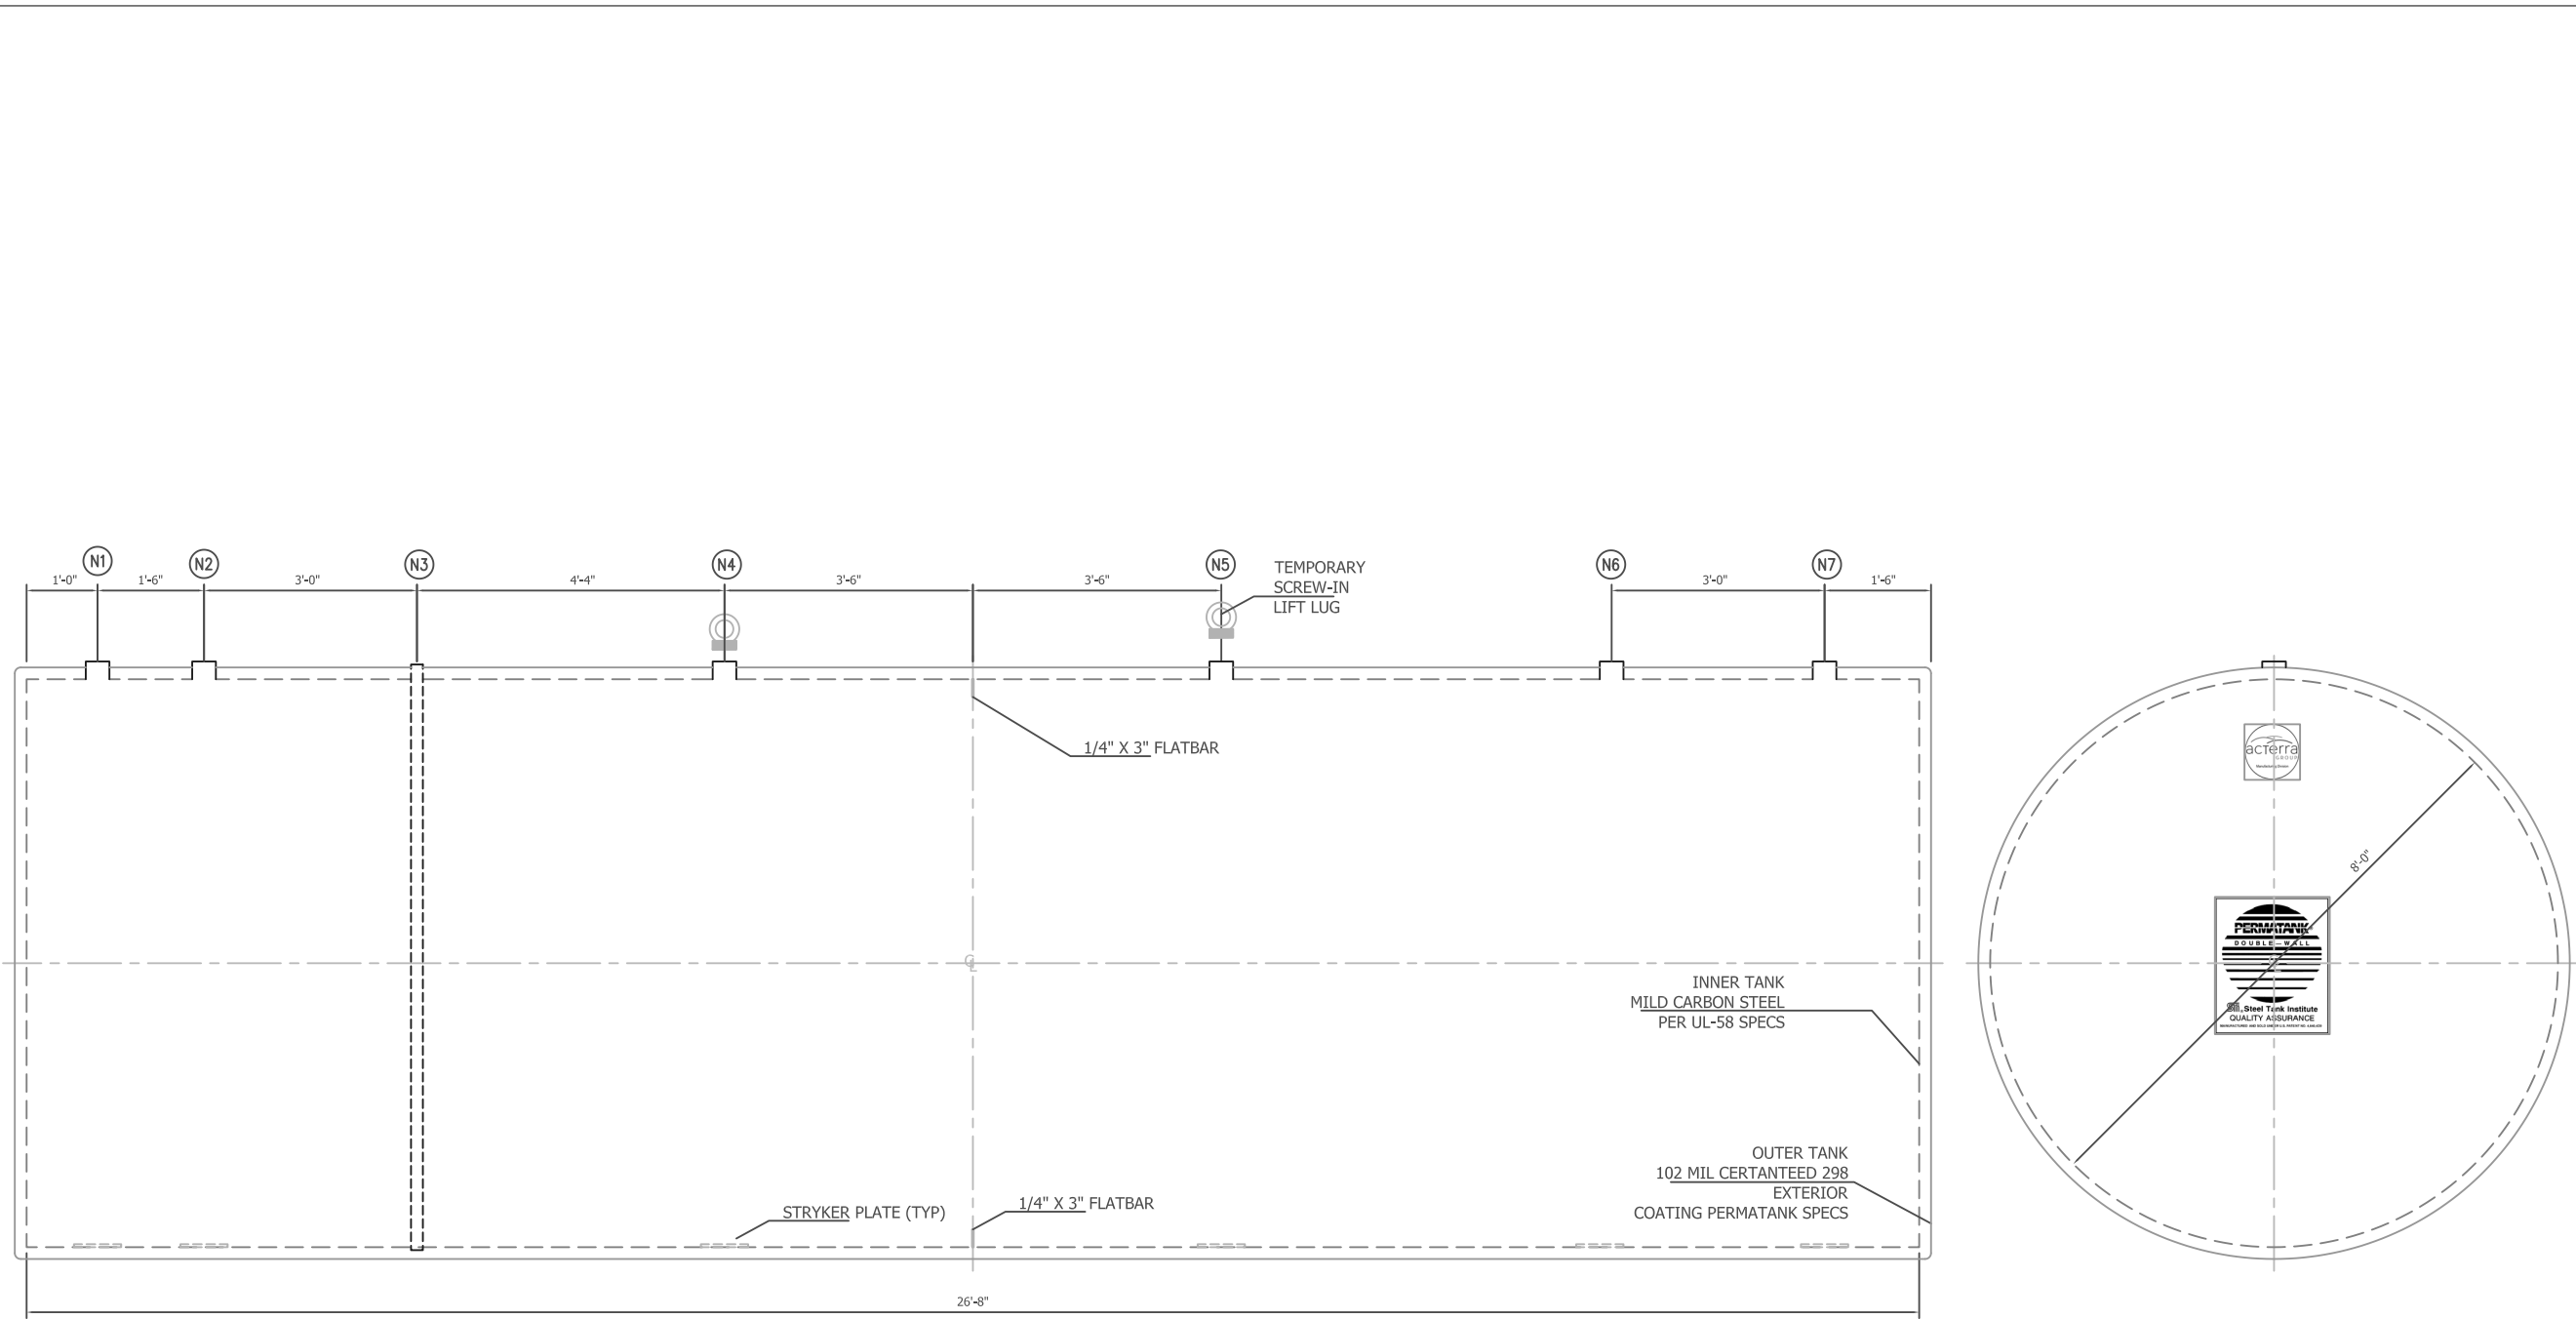

SIDE ELEVATION

END ELEVATION

GENERAL SPECIFICATIONS			
1.	ORDER QUANTITY:	1 TANK	
2.	NOMINAL CAPACITY:	10,000 GALLONS	
3.	VESSEL OPERATING PRESSURE:	ATMOSPHERIC	
4.	VESSEL OPERATING TEMPERATURE:	AMBIENT	
5.	CONSTRUCTION:	DOUBLE-WELDED BUTT JOINT	
6.	MATERIAL:	MILD CARBON STEEL	
7.	TEST:	PER UL58	
8.	APPROVED LABELS:	UL58, STI PERMATANK	
9.	EXTERIOR COATING:	SANDBLAST AND 102 MIL CERTANTEED 298 EXTERIOR	

GENERAL DIMENSIONS			
CAPACITY	DIAMETER	LENGTH	WEIGHT
10,000 GAL	8"	26'-8"	9,601 LBS

GAUGE/THICKNESS			
OUTER HEAD	OUTER SHELL	INNER HEAD	INNER SHELL
102 MIL	102 MIL	1/4"	7 GA

FITTING DETAIL			
TAG NO.	DESCRIPTION	LOCATION	NOZZLE SIZE
N1	FILL	TOP	4" FNPT
N2	GAUGE	TOP	4" FNPT
N3	INTERSTITIAL GAUGE	TOP	2" FNPT
N4	GAUGE	TOP	4" FNPT
N5	GAUGE	TOP	4" FNPT
N6	GAUGE/VENT	TOP	4" FNPT
N7	GAUGE/VENT	TOP	4" FNPT

NO.	REVISION/ISSUE	DATE

CUSTOMER INFORMATION
BHT720170

DRAWN BY: CRP	DRAWING NUMBER: TANK 001
REVIEWED BY: MEJ	DRAWING DATE: 05/15/14
SCALE: NTS	QUOTE NUMBER: BHT720170
CAD FILE NAME: 10000 GAL DWPT BHT720170.DWG	

Corporate Centre 200
PO Box 160
Marion, IA 52302-0160
T 319.377.6357
F 319.377.0075
www.acterragroup.com
Info@acterragroup.com

DISCLAIMERS
THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, INC. AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLECTUAL PROPERTY OF THE ACTERRA GROUP, INC., THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, INC. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS, THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

APPROVAL
CUSTOMER: _____
DATE: _____