


ELEVATION

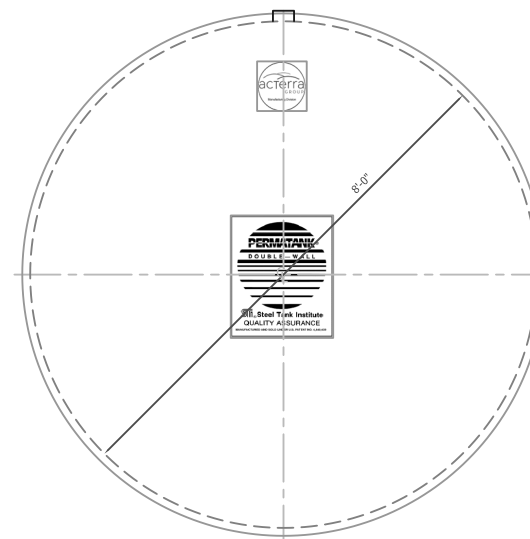

END VIEW

GENERAL SPECIFICATIONS

- ORDER QUANTITY: 1 TANK
- NOMINAL CAPACITY: 12,000 GALLONS
- VESSEL OPERATING PRESSURE: ATMOSPHERIC
- VESSEL OPERATING TEMPERATURE: AMBIENT
- CONSTRUCTION: DOUBLE-WELDED BUTT JOINT
- MATERIAL: MILD CARBON STEEL
- TEST: PER UL58
- APPROVED LABELS: UL142, STI PERMATANK
- EXTERIOR COATING: SANDBLAST AND 102 MIL CERTANTEED 298 EXTERIOR

GENERAL DIMENSIONS

CAPACITY	DIAMETER	LENGTH	WEIGHT
12,000 GAL	96"	32'-0"	11,241 LBS

GAUGE/THICKNESS

OUTER HEAD	OUTER SHELL	INNER HEAD	INNER SHELL
FRP	FRP	1/4"	1/4"

FITTING DETAIL

TAG NO.	DESCRIPTION	LOCATION	NOZZLE SIZE
N1	FILL	TOP	4" FNPT
N2	DISPENSE	TOP	4" FNPT
N3	INTERSTITIAL MONITOR	TOP	2" FNPT
N4	GAUGE/VENT	TOP	4" FNPT
N5	GAUGE/VENT	TOP	4" FNPT
N6	GAUGE/VENT	TOP	4" FNPT
N7	GAUGE/VENT	TOP	4" FNPT

NO.	REVISION/ISSUE	DATE

CUSTOMER INFORMATION
BHT720180

DRAWN BY: CRP	DRAWING NUMBER: TANK #1
REVIEWED BY: MEJ	DRAWING DATE: 05/09/14
SCALE: NTS	QUOTE NUMBER: BHT720180
CAD FILE NAME: 12000 GAL DWPT BHT720180.DWG	


 Corporate Centre 200
 PO Box 160
 Marion, IA 52302-0160
 T 319.377.6357
 F 319.377.0075
 www.acterragroup.com
 Info@acterragroup.com

DISCLAIMERS

THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, INC. AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLECTUAL PROPERTY OF THE ACTERRA GROUP, INC., THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, INC. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS, THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

APPROVAL

CUSTOMER: _____

DATE: _____

FNAME

REVDATE

USER