


SIDE ELEVATION

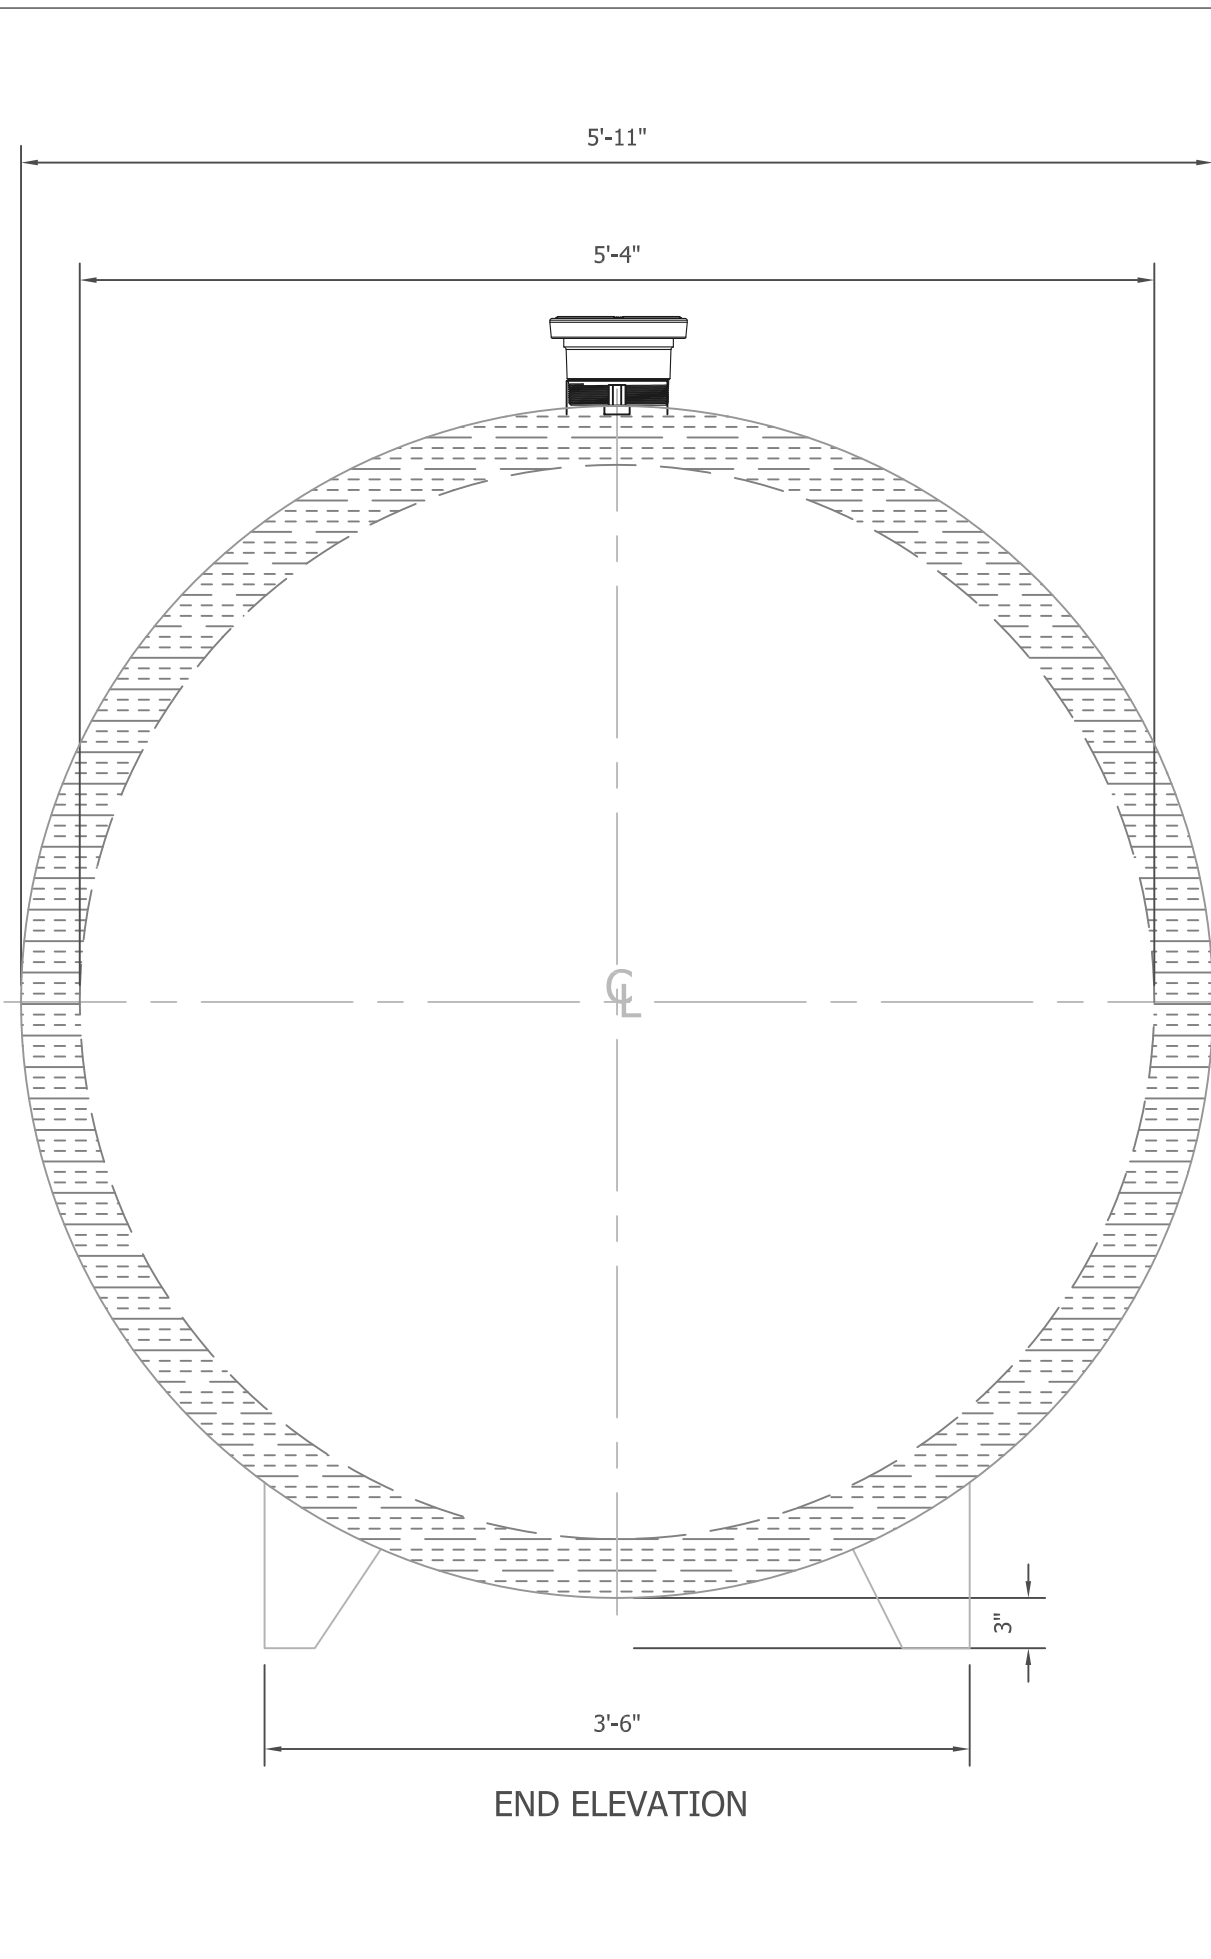

END ELEVATION

- GENERAL SPECIFICATIONS**
- ORDER QUANTITY: 1 TANK
 - NOMINAL CAPACITY: 1,000 GALLONS
 - VESSEL OPERATING PRESSURE: ATMOSPHERIC
 - VESSEL OPERATING TEMPERATURE: AMBIENT
 - CONSTRUCTION: DOUBLE-WELDED BUTT JOINT
 - MATERIAL: MILD CARBON STEEL
 - EXTERIOR COATING: SSPC-6 BLAST, PRIMER COAT & PAINT WHITE URETHANE
 - INTERIOR COATING: NONE
 - TEST: 5 PSI PER UL2085 / SWRI 93-01
 - APPROVED LABELS: SWRI 93-01, UL2085, STI FIREGUARD®
 - ALL TANK EQUIPMENT INSTALLED BY OTHERS

GENERAL DIMENSIONS

CAPACITY	DIAMETER	LENGTH	WEIGHT
1,000 GAL	5'-4"	6'-0"	4,800 LBS

GAUGE/THICKNESS

OUTER HEAD	OUTER SHELL	INNER HEAD	INNER SHELL
10 GA	10 GA	10 GA	10 GA

FITTING DETAIL

TAG NO.	DESCRIPTION	LOCATION	NOZZLE SIZE
N1	INTERSTITIAL GAUGE	TOP	2" FNPT
N2	FILL	TOP	4" FNPT
N3	GAUGE	TOP	2" FNPT
N4	EMERGENCY VENT	TOP	6" FNPT
N5	INTERSTITIAL EMERGENCY VENT	TOP	6" FNPT
N6	NORMAL VENT	TOP	2" FNPT
N7	DISPENSE	TOP	2" FNPT

NO.	REVISION/ISSUE	DATE

CUSTOMER INFORMATION
BHT620130

DRAWN BY: CRP	DRAWING NUMBER: TANK #1
REVIEWED BY: MEJ	DRAWING DATE: 03/15/14
SCALE: NTS	QUOTE NUMBER: BHT620130
CAD FILE NAME: 1000 GAL 64 FG BHT620130.DWG	

Corporate Centre 200
PO Box 160
Marion, IA 52302-0160
T 319.377.6357
F 319.377.0075
www.acterragroup.com
Info@acterragroup.com

DISCLAIMERS

THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, INC. AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLECTUAL PROPERTY OF THE ACTERRA GROUP, INC., THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, INC. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

APPROVAL

CUSTOMER: _____
DATE: _____

FNAME
REVDATE
USER